

Level Plus[®]

Magnetostrictive Liquid Level Transmitters
with Temposonics[®] Technology



RefineME[®] Application Data Sheet

Document Part Number
551692 Revision C (EN) 02/2017

L	P	R			1																	
---	---	---	--	--	---	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--

1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22

To build the sensor model number in the fields provided above, download the product specification / data sheet from the following RefineME[®] product page link and refer to the document's '**Ordering Information**':

<http://www.mtsensors.com/products/liquid-level-transmitters/RefineME/index.html>

General Info

Company name:

Email address:

Quote number:

Country of final destination:

Customer name:

Phone number:

Project name:

Factory contact:

Vessel Detail

Volume:

Height:

Diameter:

Material:

Lining:

Process connection type:

Process connection size:

Application Information

Maximum operating temperature:

Maximum operating pressure:

Vibration?: Yes No

Stilling well?: Yes No

Turbulence?: Yes No

Stilling well size:

Mixer?: Yes No

Foaming?: Yes No


Level 1

Process media:

Media specific gravity:

Viscosity:

Coating/buildup:

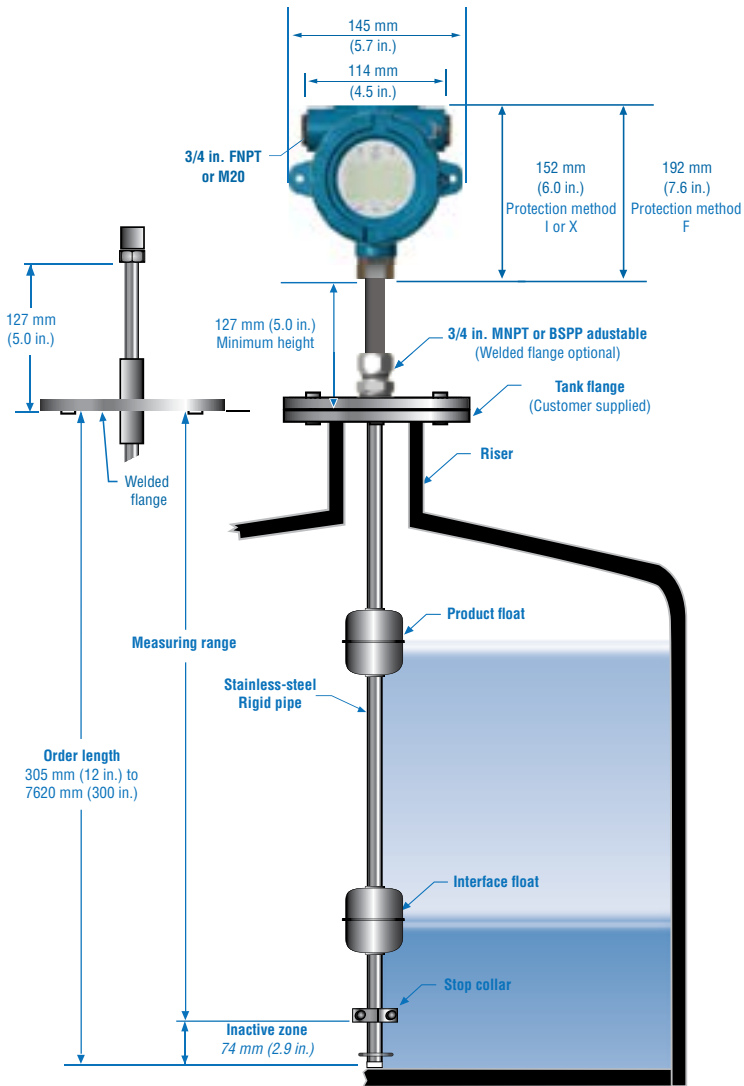

Transmitter Inactive Zone Reference

Material	Inactive zone
316L SS, Hastelloy C	74 mm (2.9 in.)
Teflon	132 mm (5.2 in.)

General Ordering Notes:

1. For Inactive Zone from the tip of the transmitter, refer to the illustration, for details see table 'Transmitter Inactive Zone Reference'.
2. Allow overhead clearance for installation and removal of transmitter.
3. All transmitter pipes come with a rigid sensor element. Flexible sensor elements are available, contact factory for more information.

Digital Ordering Notes:


1. DT 1 is 203 mm (8 in.) from the tip.
2. If you choose DT Placement Fixed, the first DT will be as described in Note 1 and the last DT will be at 80% of the order length. All other DTs will be evenly spaced.
3. If you choose DT Placement Custom, you must provide all DT locations in the Custom DT Location Table.

Analog Ordering Notes:

1. 4 to 20 mA setpoints are set at the 'Minimum' or 'Maximum' positions unless otherwise specified. 'Minimum' is set to 74 mm (2.9 in.), or 132mm (5.2 in.) as standard dependent on the material of construction. 'Maximum' is set to Order length minus 25 mm (1.0 in.) as standard.
2. Only available with one temperature measurement point. DT1 is 203 mm (8 in.) from the tip if length < 7620 mm (300 in.).

Minimum order length

Number of DTs	Minimum order length
0	305 mm (12 in.)
1	305 mm (12 in.)
5	914 mm (36 in.)
12	2032 mm (80 in.)
16	2794 mm (110 in.)



LEGAL NOTICES

Document Part Number:
551692 Revision C (EN) 02/2017

MTS, Temposonics and Level Plus are registered trademarks of MTS Systems Corporation. All other trademarks are the property of their respective owners. Printed in USA. Copyright © 2017 MTS Systems Corporation. All Rights Reserved in all media.

All specifications are subject to change. Contact MTS for specifications and engineering drawings that are critical to your application. Drawings contained in this document are for reference only. Go to <http://www.mtssensors.com> for the latest product information.

LOCATIONS

USA
MTS Systems Corporation
Sensors Division
 3001 Sheldon Drive
 Cary, N.C. 27513, USA
 Tel. +1-919-677-0100
 Fax +1-919-677-0200
info.us@mtssensors.com
www.mtssensors.com

GERMANY
MTS Sensor Technologie
GmbH & Co. KG
 Auf dem Schüffel 9
 58513 Lüdenscheid, Germany
 Tel. +49-23 51-95 87 0
 Fax +49-23 51-5 64 91
info.de@mtssensors.com
www.mtssensors.com

JAPAN
MTS Sensors Technology Corp.
 737 Aihara-machi,
 Machida-shi,
 Tokyo 194-0211, Japan
 Tel. +81-42-775-3838
 Fax +81-42-775-5512
info.jp@mtssensors.com
www.mtssensors.com